


Minimum 100mm thick, level sand or <GAP 7 or 75mm reinforced concrete slab. 150mm wider and longer than over all width and length of tanks

NOTE:  
Tanks are delivered as individual 1000L pods, assembly required onsite  
Tanks and 50mm connections supplied. All other pipes and seals supplied by others.  
Consideration should be made for seismic restraint if required.

Each 1000L pod Outlet & Inlet Details		
	Position	Details
Outlets	3	2 x 16 mm BSP
	4.30 & 7.30	2 x 50 mm BSP

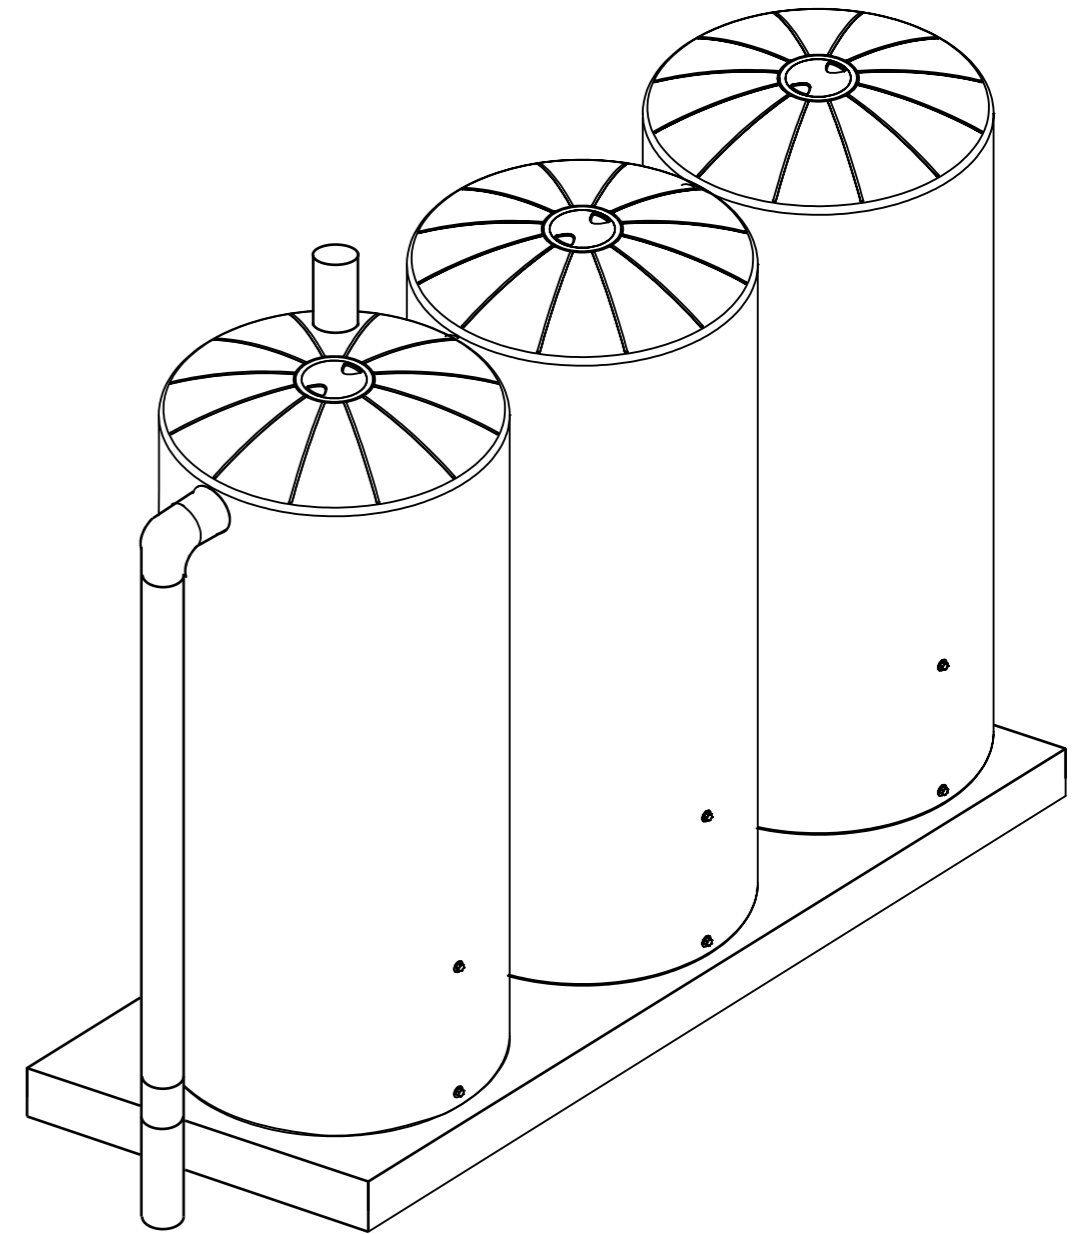

**stormBANK**  
Devan Plastic Limited

Typical Install drawing

SCALE NTS	REV 1.0	SHEET 1/1	CODE N/A
--------------	------------	--------------	-------------

Weight: N/A

DIMENSIONS ARE APPROXIMATE DUE TO VARIATIONS DURING THE MANUFACTURING PROCES